HOWARD
LIGHTING PRODUCTS

2/22/2015

Highbay Fluorescent - Four Lamp Flat Profile Design



Applications

Warehouse Gymnasium
Manufacturing Cafeteria
Facility Auditorium

Features

- Easy access to wiring compartment & ballast
- Access plate provides access to electrical wiring with-out the need to open the fixture
- Knock-outs for easy electrical wiring and assembly
- Factory Installed Occupancy Sensor option
- Factory Installed Emergency ballast option
- Lamp Installation option available
- Multiple power cord set options, (voltage, length, gage)
- Pendant mount kit provides a top J-box to simplify HID retrofit installations. Can be used with a hook or rigid conduit and fasteners (Fixture must be specified with "J" option)
- Door and lens kit options available
- Choice of 86% Standard Specular Aluminum Reflector,
 95% Specular Enhanced Aluminum Reflector or 91% White Reflector
- Heavy Duty pre-painted steel construction
- Factory Installed Wireguard option
- Custom configurations available
- Can be easily mounted by a single person
- Suspended or Pendant mounting insures a quick painless install
- Chain and V-Clip Hanging option
- Wire cable hanging option.
- UL Listed for Damp Locations


| Project: | |
|--------------|--|
| Catalog#: | |
| Approved by: | |

Description

HFA2 series high-bay fluorescent fixture is a great energy saving alternative to traditional HID high-bay fixtures. This fixture operates four lamps and as a standard feature comes equipped with Howard ballasts.

Benefits

- Energy Saving Compared to HID systems
- Exceptional Color Rendering
- High System Efficacy
- Long Lamp Life
- Instant On/Re-strike Capability
- Howard Ballast and Howard Lamp as a system is covered by Howard Industries Warranty
- Quality Lamp holders
- Computer Designed Reflectors
- System Tested, Designed, Approved, and Manufactured by Howard Industries in Mendenhall Mississippi.
- Compliant with Safety and performance standards.

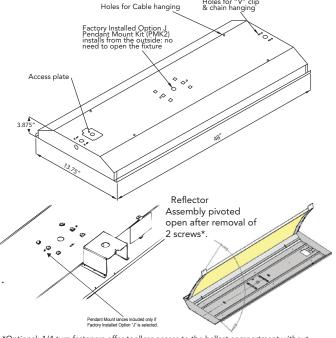

 * Optional: 1/4 turn fasteners offer toolless access to the ballast compartment without removing lamps. Simply rotate the two 1/4 turn fasteners. See Factory Installed Option Q for more information.



Highbay Fluorescent - Four LampFlat Profile Design

| Project: | |
|--------------|--|
| Catalog#: | |
| Approved by: | |

Ordering Information

| Model Family | Reflector | No. of Lamps | Lamp Type/ Wattage ⁽¹⁾ | CRI/CCT | Ballast | Input Volts | Factory Installed Options | Cordset Options (consult customer service for other cordset options) | T B A | Pack. |
|-----------------|--|-----------------|---|---|--|--|--|---|-------------|----------------------|
| HFA2 | Е | 4 | 54 | Α | PS | MV | 0AC | 07 | 0 | - 1 |
| HFA2 | E: Enhanced Specular Aluminum (95%) F: Enhanced Specular Enhanced Performance (95%) A: Specular Aluminum (86%) W: White reflective (91%) | 4 | T8 Lamps 28: F28T8 32: F32T8 T5 Lamps 28:F28T5 54: F54T5HO | CRI CCT High Lumen T8 T5 A: No Lamps B: 75 3000 | SE: SBF High Eff ⁽²⁾ HE: HBF High Eff ⁽²⁾ LE: LBF High Eff ⁽²⁾ PS: PRS T5 P8: PRS T8 ⁽²⁾ | MV: 120-277v HV: 347-480v (T5HO) AX: 480-277 ⁽³⁾ | 000: No FIOs A: Occ Sensor ⁽⁴⁾ B: Emergency Ballast ⁽⁵⁾ C: Door W/Lens & Safety Cable ⁽⁶⁾ D: Door W/Lens ⁽⁶⁾ G: Wireguard I: Special Wiring Instructions J: J-box config. ⁽⁷⁾ T: Toggle switch bilevel lighting control ⁽⁸⁾ Q: Quarter Turn Fasteners ⁽⁹⁾ | 00: Standard Disconnect 01: 6' SJT 18/3, no plug 02: 10' SJT 18/3, no plug 03: 6' SJT 18/3 L5-15, twist lock 120v 04: 10' SJT 18/3 L5-15twist lock 120v 05: 6' SJT 18/3 5-15non twist lock 120v 06: 10' SJT 18/3 5-15non twist lock 120v 07: 6' SJT 18/3 L7-15 twist lock 277v 08: 10' SJT 18/3 L7-15 twist lock 277v 09: 6' SJT 7-15 non twist lock 277v 10: 10' SJT 7-15 non twist lock 277v 11: 16/3, no plug specify length 12: 16/4, no plug specify length 16: 16' SJT 18/3 7-15, non twist lock 277v 17: 18/3, no plug specify length 18: 6' STW L8-20, twist lock 480v 19: 10' STW L8-20, twist lock 480v 20: 16' SJT 18/3 L5-15, twist lock 120v 21: 16' SJT 18/3 L5-15, twist lock 277v | | I: Single B: Bulk |

- (1) Lamp installation available.
- (2) High Efficiency ballasts are CEE Listed.
- (3) Step-down autotransformer. Allows hook-up of standard MV ballast to 480v.
- (4) Occupancy Sensors should be used with programmed rapid start ballasts for maximum lamp life. Standard Occupancy Sensor requires neutral wired fixtures (ex. -120v or -277v). For phase-to-phase voltage applications (240v) advise Customer Service at time of request.
- For phase-to-phase voltage applications (240v) advise Customer Service at time of request.
- (5) Please specify Emergency Ballast (120-277v only) lumen requirements at time of request.
- (6) Standard acrylic prismatic, pattern 12, 0.100" thick. Call for options.
- (7) Unless otherwise specified, fixture will include field installed J-box. Supply wires will exit the center of the fixture, not the access plate. J-box can be installed without entering the fixture.
- (8) Allows for separate control of two ballasts through simple "toggling" of a standard wall switch. Recommend use of programmed rapid start ballast with this control.
- (9) 1/4 Turn Fasteners for toolless access to ballast compartment. Does not require lamp removal.

| SE | Standard Ballast Factor High Efficiency Instant Start T8 Ballast | | | | | | |
|----|--|--|--|--|--|--|--|
| HE | High Ballast Factor High Efficiency Instant Start T8 Ballast | | | | | | |
| LE | Low Ballast Factor High Efficiency Instant Start T8 Ballast | | | | | | |
| PS | Program Rapid Start T5 Ballast | | | | | | |
| P8 | P8 Program Rapid Start High Efficiency T8 Ballast | | | | | | |
| Sp | Specifications subject to change without notice. | | | | | | |

HFA2 Series Highbay Fluorescent
Enhanced Specular Aluminum Reflector
4-lamps (none installed)
F54T5HO Program Rapid Start Ballast
Multi-volt (120-277v)
Factory Installed Occupancy Sensor

Factory Installed Door with Lens & Safety Cable 6' SJT 18/3 L7-15 twist lock 277v Cordset Single Packaging

RAPID SHIP MODELS AVAILABLE FOR NEXT DAY SHIPMENT

HFA2A454APSMV000000I

Sample Ordering Number:

HFA2 E 4 54 A PS MV 0AC 07 I

- HFA2E432AHEMV000000I
- •HFA2E454APSMV000000I






Highbay Fluorescent

Field Installed Options Ordering

| Project: | |
|--------------|--|
| Catalog#: | |
| Approved by: | |




HFA2-WG Wire Guard



HFA-WCH Wire Cable Hanging Kit (2 pcs per kit)



HF-PMK2
Pendant Mount Kit
with 1.0" diameter through hole



HF-2CV (2 foot) HF-3CV (3 foot) Hanging Chain & V-clips



HF-SK1 Stabilizer Kit (Hub, color and wire cable)

| Energy Cost Estimator | | | | | | | | |
|-----------------------------|-------|--|----------------------|--|-------|--|--|--|
| | | Existing | System | New System | | | | |
| | | 400W MH | Highbay | HFA2E454APS Program Start T5 Ballast Fluorescent Highbay | | | | |
| Hours burned per year | 4368 | Number of Fixtures | 1 | Number of Fixtures | 1 | | | |
| Cost per kWh\$ | 0.12 | Watts per Fixture (existing system) | 458 | Watts per Fixture (new system) | 234 | | | |
| Energy | Cost | Energy used per year (existing system) | \$240 | Energy used per year (new system) | \$123 | | | |
| Estima | ation | Energy sa year (per | ving per fixture) | \$117.00 | | | | |






Highbay Fluorescent

Photometric Data - 4 Lamp T8 (HFA2E432)

Candela Polar Plot

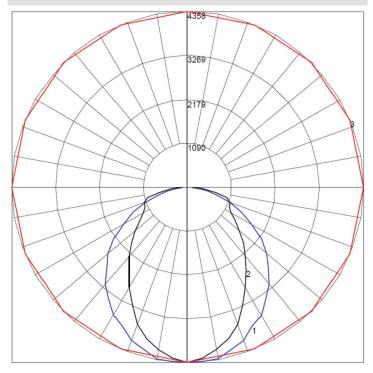

HFA2E432 Test Report: HFA2E432.ies Spacing Criteria (0-180): 1.26 Spacing Criteria (90-270): 0.92 Spacing Criteria (Diagnonal): 1.16

Maximum Candela = 4358.13

Located at Horizontal Angle = 0, Vertical Angle = 5

#1 = Vertical Plane Through Horizontal Angles (0-180) Through Max Cd.

#2 = Vertical Plane Through Horizontal Angles (45-225) #3 = Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)

Project: Catalog#: Approved by:

Luminaire Efficiencies*

| Reflector Type | T8 |
|-------------------|-----|
| Enhanced Specular | 91% |
| Specular | 86% |
| White | 86% |

^{*}Luminaire efficiency is the ratio of light output emitted by the luminaire to the light output emitted by its lamps.

Zonal Lumen Summary

| Zone | Lumens | %Lamp | %Fix |
|-------|----------|-------|--------|
| 0-30 | 3025.59 | 26.10 | 28.80 |
| 0-40 | 4723.33 | 40.70 | 44.90 |
| 0-60 | 7839.79 | 67.60 | 74.60 |
| 0-90 | 10510.33 | 90.60 | 100.00 |
| 0-180 | 10510.33 | 90.60 | 100.00 |

Luminance Data (cd/Sq.m)

| Angle In Degrees | Average 0-deg | Average 45-deg | Average 90-deg |
|---------------------|------------------|-------------------|-------------------|
| 45 | 10207 | 6623 | 5976 |
| 55 | 9802 | 5726 | 5941 |
| 65 | 8605 | 5849 | 7791 |
| 75 | 7250 | 7410 | 7863 |
| 85 | 5523 | 4788 | 4835 |

Coefficients of Utilization - Zonal Cavity Method


| Effect | Effective Floor Cavity Reflectance 0.20 | | | | | | | | | | | | | | | | | |
|--------|---|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|
| RC | | 8 | 0 | | | 7 | 0 | | | 50 | | | 30 | | | 10 | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| 0 | 108 | 108 | 108 | 108 | 105 | 105 | 105 | 105 | 101 | 101 | 101 | 96 | 96 | 96 | 92 | 92 | 92 | 91 |
| 1 | 98 | 93 | 89 | 85 | 95 | 91 | 87 | 83 | 87 | 84 | 81 | 83 | 81 | 78 | 80 | 78 | 76 | 74 |
| 2 | 88 | 81 | 74 | 69 | 86 | 79 | 73 | 68 | 76 | 71 | 66 | 73 | 68 | 65 | 70 | 66 | 63 | 61 |
| 3 | 81 | 71 | 63 | 57 | 78 | 69 | 62 | 56 | 67 | 60 | 55 | 64 | 59 | 54 | 62 | 57 | 53 | 51 |
| 4 | 74 | 63 | 55 | 48 | 72 | 62 | 54 | 48 | 59 | 53 | 47 | 57 | 51 | 47 | 55 | 50 | 46 | 44 |
| 5 | 68 | 56 | 48 | 42 | 66 | 55 | 47 | 42 | 53 | 46 | 41 | 51 | 45 | 41 | 50 | 45 | 40 | 38 |
| 6 | 63 | 51 | 43 | 37 | 61 | 50 | 42 | 37 | 48 | 41 | 36 | 47 | 41 | 36 | 45 | 40 | 36 | 34 |
| 7 | 59 | 46 | 38 | 33 | 57 | 46 | 38 | 33 | 44 | 37 | 32 | 43 | 37 | 32 | 42 | 36 | 32 | 30 |
| 8 | 55 | 42 | 35 | 29 | 53 | 42 | 34 | 29 | 41 | 34 | 29 | 39 | 33 | 29 | 38 | 33 | 29 | 27 |
| 9 | 51 | 39 | 32 | 27 | 50 | 39 | 31 | 26 | 37 | 31 | 26 | 36 | 30 | 26 | 36 | 30 | 26 | 24 |
| 10 | 48 | 36 | 29 | 24 | 47 | 36 | 29 | 24 | 35 | 28 | 24 | 34 | 28 | 24 | 33 | 28 | 24 | 22 |



Highbay Fluorescent

Photometric Data - 4 Lamp T5 (HFA2E454)

Candela Polar Plot

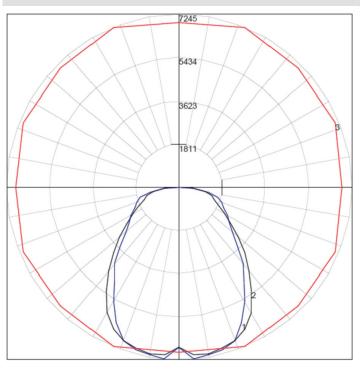

HFA2E454

Test Report: HFA2E454.ies Spacing Criteria (0-180): 1.32 Spacing Criteria (90-270): 1.20 Spacing Criteria (Diagnonal): 1.32

Maximum Candela = 7245.18

Located at Horizontal Angle = 67.5, Vertical Angle = 5

#1 = Vertical Plane Through Horizontal Angles (67.5-247.5) Through Max Cd.

#2 = Vertical Plane Through Horizontal Angles (45-225)

#3 = Horizontal Cone Through Vertical Angle (5) (Through Max. Cd.)

Project: Catalog#: Approved by:

Luminaire Efficiencies*

| Reflector Type | T5 |
|-------------------|-----|
| Enhanced Specular | 94% |
| Specular | 89% |
| White | 89% |

^{*}Luminaire efficiency is the ratio of light output emitted by the luminaire to the light output emitted by its lamps.

Zonal Lumen Summary

| Zone | Lumens | %Lamp | %Fix |
|-------|----------|-------|--------|
| 0-30 | 5570.54 | 27.90 | 29.60 |
| 0-40 | 8871.01 | 44.40 | 47.10 |
| 0-60 | 14660.99 | 73.30 | 77.80 |
| 0-90 | 18842.01 | 94.20 | 100.00 |
| 0-180 | 18842.01 | 94.20 | 100.00 |

Luminance Data (cd/Sq.m)

| Angle In Degrees | Average 0-deg | Average 45-deg | Average 90-deg |
|---------------------|------------------|-------------------|-------------------|
| 45 | 17691 | 13785 | 11702 |
| 55 | 16775 | 11103 | 10989 |
| 65 | 15299 | 10000 | 11227 |
| 75 | 13001 | 10801 | 13185 |
| 85 | 8582 | 8610 | 7941 |

Coefficients of Utilization - Zonal Cavity Method

| Effect | Effective Floor Cavity Reflectance 0.20 | | | | | | | | | | | | | | | | | |
|--------|---|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|
| RC | RC 80 | | | 70 | | | 50 | | 30 | | | 10 | | | 0 | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| 0 | 112 | 112 | 112 | 112 | 110 | 110 | 110 | 110 | 105 | 105 | 105 | 100 | 100 | 100 | 96 | 96 | 96 | 94 |
| 1 | 102 | 97 | 93 | 89 | 99 | 95 | 91 | 88 | 91 | 88 | 85 | 87 | 85 | 82 | 84 | 82 | 80 | 78 |
| 2 | 93 | 85 | 78 | 73 | 90 | 83 | 77 | 72 | 80 | 75 | 70 | 77 | 72 | 69 | 74 | 70 | 67 | 65 |
| 3 | 85 | 75 | 67 | 61 | 82 | 73 | 66 | 60 | 70 | 64 | 59 | 68 | 63 | 58 | 65 | 61 | 57 | 55 |
| 4 | 78 | 66 | 58 | 52 | 76 | 65 | 57 | 51 | 63 | 56 | 51 | 61 | 55 | 50 | 59 | 54 | 49 | 47 |
| 5 | 72 | 60 | 51 | 45 | 70 | 59 | 51 | 45 | 57 | 50 | 44 | 55 | 49 | 44 | 53 | 48 | 43 | 41 |
| 6 | 66 | 54 | 45 | 39 | 65 | 53 | 45 | 39 | 51 | 44 | 39 | 50 | 43 | 39 | 48 | 43 | 38 | 36 |
| 7 | 62 | 49 | 41 | 35 | 60 | 48 | 40 | 35 | 47 | 40 | 35 | 45 | 39 | 34 | 44 | 38 | 34 | 32 |
| 8 | 58 | 45 | 37 | 31 | 56 | 44 | 37 | 31 | 43 | 36 | 31 | 42 | 35 | 31 | 41 | 35 | 31 | 29 |
| 9 | 54 | 41 | 34 | 28 | 52 | 41 | 33 | 28 | 40 | 33 | 28 | 39 | 32 | 28 | 38 | 32 | 28 | 26 |
| 10 | 51 | 38 | 31 | 26 | 49 | 38 | 31 | 26 | 37 | 30 | 26 | 36 | 30 | 26 | 35 | 29 | 25 | 24 |




Highbay Fluorescent

Photometric Data - 4 Lamp T5 (HFA2F454)

Project: Catalog#: Approved by:

Candela Polar Plot

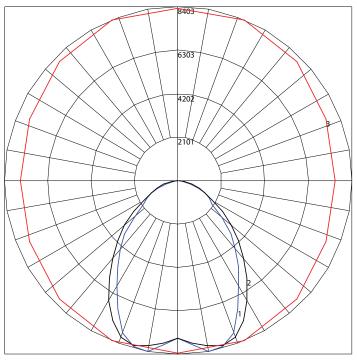

HFA2F454

Test Report: HFA2F454.ies Spacing Criteria (0-180): 1.30 Spacing Criteria (90-270): 1.14 Spacing Criteria (Diagnonal): 1.28

Maximum Candela = 8403.49

Located at Horizontal Angle = 67.5, Vertical Angle = 10

#1 = Vertical Plane Through Horizontal Angles (67.5-247.5) Through Max Cd.

#2 = Vertical Plane Through Horizontal Angles (45-225)

#3 = Horizontal Cone Through Vertical Angle (10) (Through Max. Cd.)

Luminaire Efficiencies*

| Reflector Type | T5 |
|----------------------|-----|
| Enhanced Performance | 93% |

*Luminaire efficiency is the ratio of light output emitted by the luminaire to the light output emitted by its lamps.

Zonal Lumen Summary

| Zone | Lumens | %Lamp | %Fix |
|-------|----------|-------|--------|
| 0-30 | 6325.09 | 31.60 | 33.90 |
| 0-40 | 9953.39 | 49.80 | 53.40 |
| 0-60 | 15898.08 | 79.50 | 85.20 |
| 0-90 | 18652.73 | 93.30 | 100.00 |
| 0-180 | 18652.73 | 93.30 | 100.00 |

Luminance Data (cd/Sq.m)

| Angle In Degrees | Average 0-deg | Average 45-deg | Average 90-deg |
|---------------------|------------------|-------------------|-------------------|
| 45 | 16404 | 10848 | 8899 |
| 55 | 15423 | 7846 | 5666 |
| 65 | 13121 | 4989 | 4773 |
| 75 | 9476 | 3241 | 2351 |
| 85 | 3207 | 662 | 697 |

Coefficients of Utilization - Zonal Cavity Method

| Effect | Effective Floor Cavity Reflectance 0.20 | | | | | | | | | | | | | | | | | |
|--------|---|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|
| RC | RC 80 | | | 70 | | | 50 | | 30 | | | 10 | | | 0 | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| 0 | 111 | 111 | 111 | 111 | 108 | 108 | 108 | 108 | 104 | 104 | 104 | 99 | 99 | 99 | 95 | 95 | 95 | 93 |
| 1 | 103 | 99 | 95 | 92 | 100 | 97 | 93 | 90 | 93 | 90 | 88 | 89 | 87 | 85 | 86 | 84 | 82 | 80 |
| 2 | 94 | 87 | 81 | 77 | 92 | 85 | 80 | 76 | 82 | 78 | 74 | 79 | 76 | 72 | 76 | 73 | 71 | 69 |
| 3 | 87 | 78 | 71 | 65 | 84 | 76 | 70 | 64 | 73 | 68 | 63 | 71 | 66 | 62 | 69 | 65 | 61 | 59 |
| 4 | 80 | 69 | 62 | 56 | 78 | 68 | 61 | 56 | 66 | 60 | 55 | 64 | 58 | 54 | 62 | 57 | 53 | 51 |
| 5 | 74 | 62 | 55 | 49 | 72 | 61 | 54 | 49 | 60 | 53 | 48 | 58 | 52 | 48 | 56 | 51 | 47 | 45 |
| 6 | 68 | 57 | 49 | 43 | 67 | 56 | 48 | 43 | 54 | 48 | 43 | 53 | 47 | 42 | 51 | 46 | 42 | 40 |
| 7 | 64 | 52 | 44 | 38 | 62 | 51 | 44 | 38 | 50 | 43 | 38 | 48 | 42 | 38 | 47 | 42 | 38 | 36 |
| 8 | 59 | 47 | 40 | 35 | 58 | 47 | 40 | 35 | 46 | 39 | 34 | 44 | 38 | 34 | 43 | 38 | 34 | 32 |
| 9 | 56 | 44 | 36 | 31 | 54 | 43 | 36 | 31 | 42 | 36 | 31 | 41 | 35 | 31 | 40 | 35 | 31 | 29 |
| 10 | 52 | 40 | 33 | 29 | 51 | 40 | 33 | 29 | 39 | 33 | 28 | 38 | 32 | 28 | 37 | 32 | 28 | 27 |