



P.O. BOX 11846 TUCSON, AZ 85734
(520) 294-3292 • FAX (520) 741-2837
www.iotaengineering.com

I-13-EM-B

SERIES D
COMPACT LAMP
EMERGENCY
LIGHTING EQUIPMENT

INSTRUCTION MANUAL

IMPORTANT SAFEGUARDS

When using electrical equipment, basic safety precautions should always be followed, including the following:

READ AND FOLLOW ALL SAFETY INSTRUCTIONS

1. **CAUTION** – To prevent electrical shock, do not mate unit connector until installation is complete and A.C. power is supplied to the unit.
2. **CAUTION** – This fixture provides more than one power supply output source. To reduce the risk of electrical shock, disconnect both normal and emergency sources by turning off the A.C. branch circuit and by disconnecting the unit connector.
3. **CAUTION** – This is a sealed unit. The integral, high temperature Ni-Cad battery is not replaceable. Replace the entire unit when necessary and recycle or dispose of the nickel-cadmium battery properly.
4. **DO NOT USE OUTDOORS.** The **I-13-EM-B** is for use with grounded, UL Listed, damp location rated, indoor fixtures. Not for use in heated air outlets or hazardous locations.
5. The **I-13-EM-B** requires an unswitched A.C. power source of either 120 or 277 volts. Properly cap the unused A.C. lead.
6. When the installation is complete, switch the A.C. power on and join the **I-13-EM-B** unit connector.
7. Do not mount near gas or electric heaters.
8. The **I-13-EM-B** should be mounted in locations and at heights where it will not readily be subjected to tampering by unauthorized personnel.
9. The **I-13-EM-B** will cold strike and operate *one* 5W, 7W, or 9W, twin tube, double twin tube, 180ma or 13W twin tube, double twin tube, 285ma fluorescent lamp, each with a single lampholder per lamp.
10. The **I-13-EM-B** is for use with fluorescent downlight fixtures.
11. Suitable for use in damp locations and in enclosed and gasketed fixtures.
12. When used in conjunction with enclosed and gasketed fixtures, the **I-13-EM-B** is suitable for mounting in the ballast compartment only.
13. For use in 0° C minimum, 50° C maximum ambient temperatures.
14. The use of accessory equipment not recommended by the manufacturer may cause an unsafe condition, void warranty, and result in non-compliance with UL specifications.
15. Do not use this equipment for other than intended use.
16. When the installation is complete, switch the A.C. power on and join the **I-13-EM-B** unit connector.. Install in accordance with the National Electrical Code and local regulations.
17. Installation and servicing should be performed by qualified personnel.
18. Lighting fixture manufacturers, electricians and end users need to ensure product system compatibility before final installation.

SAVE THESE INSTRUCTIONS



THIS UNIT CONTAINS A
RECHARGEABLE NICKEL-CADMIUM BATTERY.
PLEASE RECYCLE OR DISPOSE OF PROPERLY.

Ni-Cd

INSTALLATION INSTRUCTIONS

CAUTION: Before installing, make certain the A.C. power is off and the I-13-EM-B unit connector is disconnected.

1. MOUNTING THE I-13-EM-B

Mount the I-13-EM-B in the ballast channel or enclosed wireway so the wire leads are not exposed, at least 1/2" away from the A.C. ballast(s). Refer to *Illustrations 1 and 2*.

When battery packs are remote mounted, consult Customer Service for the maximum allowable distance between the battery pack and the lamp.

2. WIRING

Refer to the wiring diagrams on the back page for the appropriate wiring of lamp(s), ballast and I-13-EM-B. Install in accordance with National Electrical Code and local regulations. For wiring diagrams of ballasts not shown, consult Customer Service.

3. INSTALLING THE CHARGE INDICATOR


Downlight Fixture— Select a convenient location on the fixture so that the **Charge Indicator** can be seen after installation. Allow for proper clearance and drill or punch a 1/2" mounting hole. Disconnect the leads from the **Charge Indicator**. Push the **Charge Indicator** into the 1/2" hole until it is firmly locked into place. Reconnect the leads, observing proper polarity (Red/Black or Red lead w/connector to positive (+) red tab). Make certain all leads are enclosed in an appropriate wireway. Refer to *Illustrations 1 and 2*.

NOTE: To ensure proper operation, use only the test accessories provided with the unit. See *Page 1 of the Instruction Manual*.

4. INSTALLING THE TEST SWITCH


Downlight Fixture— The **Test Switch** should be mounted on the fixture to allow access to authorized personnel. Drill or punch a 1/2" mounting hole. Make certain all leads are enclosed in an appropriate wireway. Refer to *Illustrations 1 and 2*.

Illustration 1
Downlight Fixture

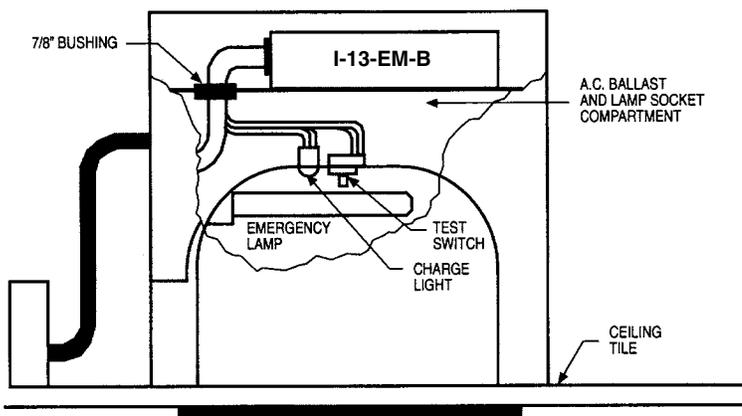

NOTE: Position the Charge Indicator so that it can be seen after installation.

Illustration 2
Charge Indicator Light (LED)

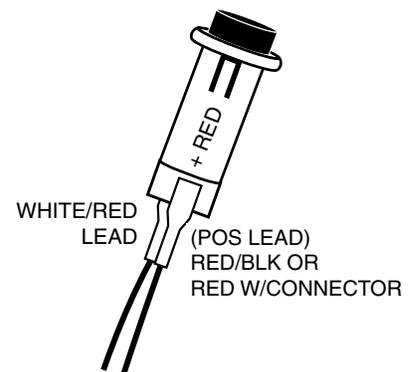

OBSERVE PROPER POLARITY

INSURE WIRING IS IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND LOCAL REGULATIONS.

5. LABELS

Attach the appropriate labels adjacent to the **Test Switch** and **Charge Indicator**. Annotate Re-lamping label for lamp type and wattage. The Caution and the Re-lamping labels must be on the fixture in a readily visible location to anyone attempting to service the fixture.

6. COMPLETING INSTALLATION

- A. When the installation is complete, switch the A.C. power on and join the **I-13-EM-B** unit connector.
- B. Replace the ballast cover, fixture lens and other fixture hardware.

OPERATION

General – This unit is primarily designed to be used with compact fluorescent lamp downlight fixtures. It will wire in conjunction with the existing A.C. ballast(s) and lamp(s) to provide the emergency function. It can also be wired for emergency only operation.

Normal Mode – A.C. power is present. The A.C. ballast operates the fluorescent lamp(s) as intended. The **I-13-EM-B** is in the standby charging mode. The **Charge Indicator** will be lit providing a visual indication that the battery is being charged.

Emergency Mode – The A.C. power fails. The **I-13-EM-B** senses the A.C. power failure and automatically switches to the *Emergency Mode*. One lamp is illuminated, at reduced output, for a minimum of 90 minutes. When the A.C. power is restored, the **I-13-EM-B** switches the system back to the *Normal Mode* and resumes battery charging. See page 1 of the Instruction Manual.

TESTING & MAINTENANCE

Initial Testing – Allow the unit to charge approximately 1 hour, then conduct a short discharge test by depressing the **Test Switch**. The **Charge Indicator** light will go out and the fluorescent tube will be illuminated. When the **I-13-EM-B** is used in fixtures with more than one A.C. ballast, the second A.C. ballast is NOT de-energized with the **Test Switch**. It may, therefore, be advisable to switch the A.C. fixture power off prior to depressing the **Test Switch**. Allow a 24 hour charge before conducting a one hour test.

The **I-13-EM-B** is a maintenance free unit, however, periodic inspection and testing is required. NFPA 101, Life Safety Code, outlines the following schedule:

Monthly – Insure that the **Charge Indicator** light is illuminated. Conduct a 30 second discharge test by depressing the **Test Switch**. One lamp should operate at reduced output.

Annually – Insure that the **Charge Indicator** light is illuminated. Conduct a full 1½ hour discharge test. The unit should operate as intended for the duration of the test.

“Written records of testing shall be kept by the owner for inspection by the authority having jurisdiction.”


SERVICING SHOULD BE PERFORMED BY QUALIFIED PERSONNEL.
Consult Customer Service or visit www.iotaengineering.com for current warranty information.

TYPICAL WIRING DIAGRAMS


For use with 2 pin, 5 through 13 watt lamps with integral starter only

Wiring and Troubleshooting Tips are available on-line at <http://www.iotaengineering.com/wiringtips.pdf>


1. ONE LAMP MAGNETIC BALLAST

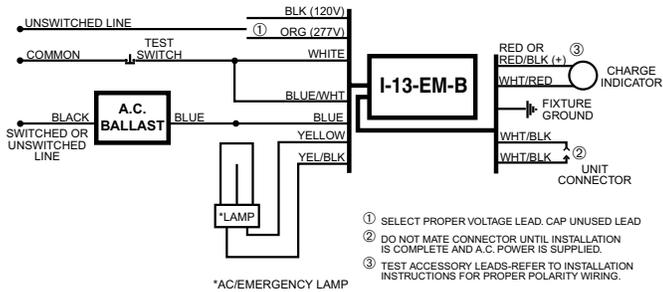


2. ONE LAMP HIGH POWER FACTOR MAGNETIC BALLAST

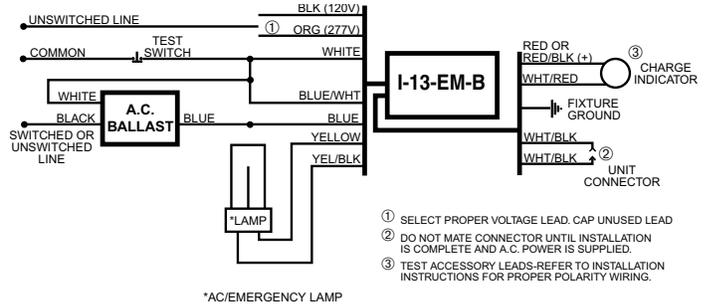


3. ONE LAMP ELECTRONIC BALLAST

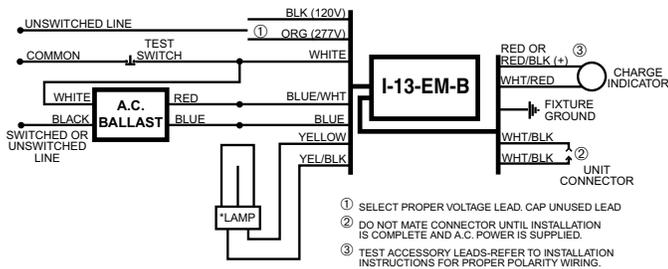


4. TWO LAMP ELECTRONIC BALLAST

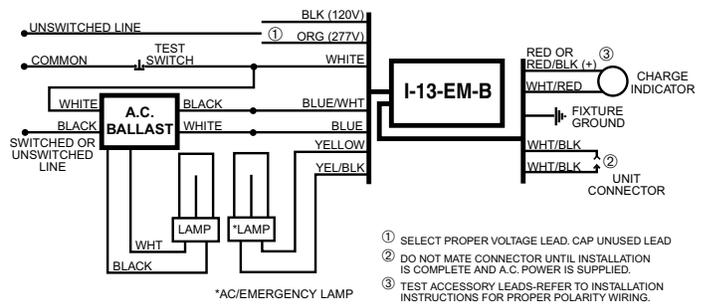


5. TWO LAMP PARALLEL MAGNETIC BALLAST

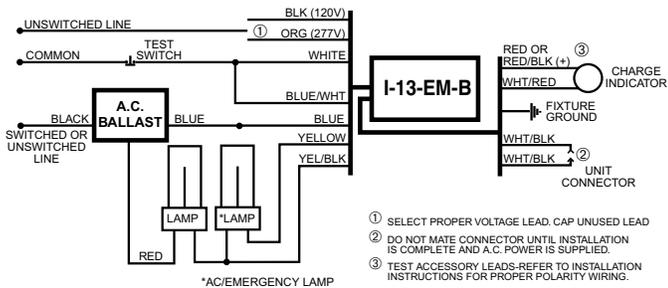


6. TWO LAMP PARALLEL HIGH POWER FACTOR MAGNETIC BALLAST

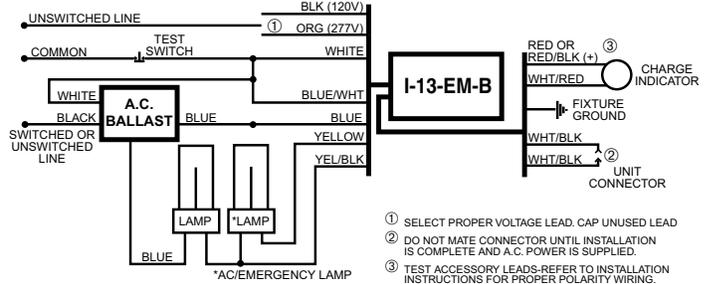

7. TWO LAMP SERIES MAGNETIC BALLAST

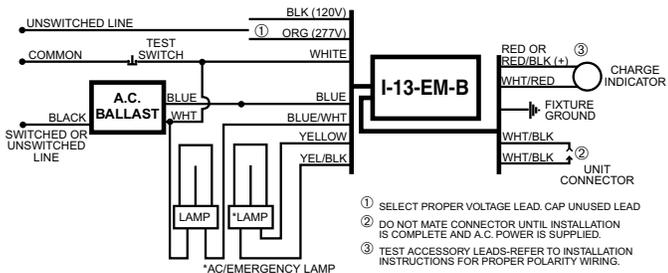

8. TWO LAMP SERIES HIGH POWER FACTOR MAGNETIC BALLAST

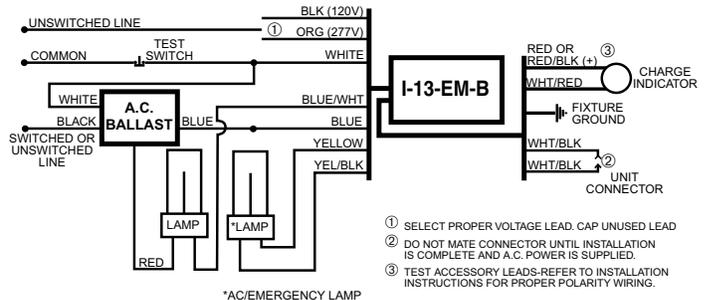


TYPICAL WIRING DIAGRAMS

For use with 2 pin, 5 through 13 watt lamps with integral starter only.

Wiring and Troubleshooting Tips are available on-line at <http://www.iotaengineering.com/wiringtips.pdf>

9. TWO NORMAL POWER FACTOR MAGNETIC BALLASTS

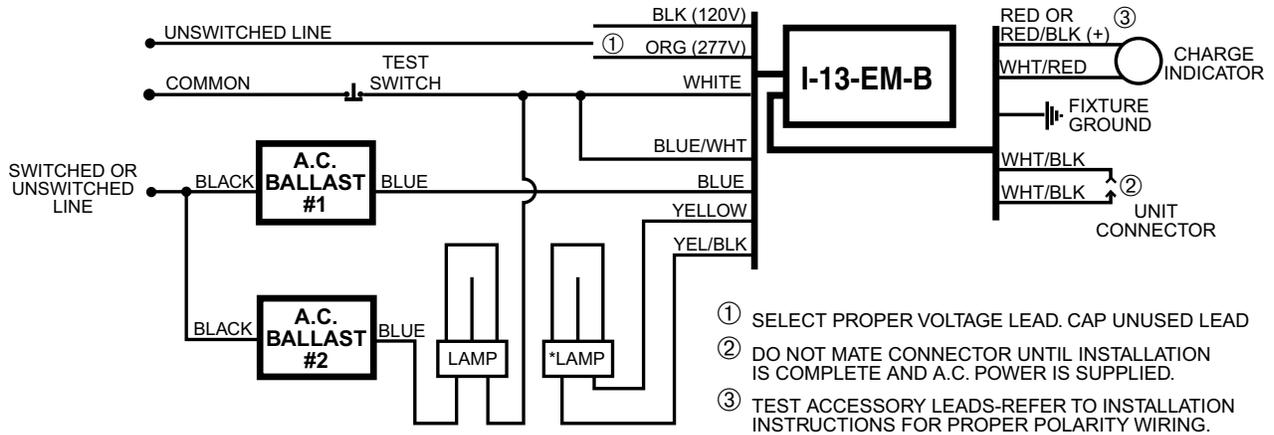

10. TWO HIGH POWER FACTOR MAGNETIC BALLASTS

