

PSD 24V Class 2 dimming series - Installation Instructions


Models PSD-48-24, PSD-96-24, and PSD-288-24

Please read all instructions prior to installation and keep for future reference!

This power supply is to be installed by a qualified electrician in accordance with the National Electrical Code (NEC) and local building codes. The power supply must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. Power supply is well suited for LED or resistive loads at or below their maximum output rating per circuit.



7777 N. Merrimac Ave
Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

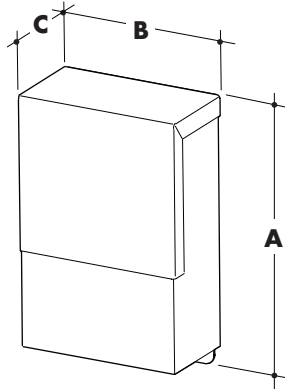

Models	PSD-48-24	PSD-96-24	PSD-288-24*
A Height	11.25"	11.25"	13.06"
B Width	3.42"	3.42"	8.42"
C Depth	3.42"	3.27"	4.47"
Output amps	2.0 A	4.0 A	4.0 A per circuit
Maximum wattage	48W	96W	96W x3 circuits
Rating	Nema 3R UL listed	Nema 3R UL listed	Nema 3R ETL listed

*Do not interconnect output circuits.

1 Before installing, check the label and ensure the power supply has the proper input voltage, output voltage, and wattage for the job. Check the wire markings to ensure they match the wiring diagram below. Refer to table above for the maximum loads!

mount top screw first to fit in keyhole on the back of the power supply and then secure power supply on the wall with bottom screw

It is recommended that the power supply be mounted vertically with the wiring compartment and conduit openings pointing down. Mount a minimum of 12" above ground level or deck, 24" below ceiling, and allow 4" of clearance around power supply (excluding the mounting side) to provide for proper air circulation.

2 Remove the wiring compartment cover and knockouts. With power off, route the input wires through knockout and connect LOAD to black wire and NEUTRAL to white wire. For all wire connections use only listed wire nuts and connectors of suitable size and type.

use No. 12-22 AWG Cu wires for line voltage connection

use only listed wire nuts for all connections

LINE VOLTAGE
120, 244, or 277 VAC, depends on model ordered.

24 VDC

3

PSD-48 & PSD-96 connections only

PSD-288 model terminal connections only

use luminii voltage drop calculator (<http://www.luminii.com/tools.aspx>) to calculate wire gage for low-voltage connection

24 VDC

For the 48 & 96 watt version connect the positive to the red wire and negative to the black wire. For the 288 watt version (3x96W) reference diagram above. Connect the ground wire in accordance with local electrical codes.

4 This power supply can be dimmed low-voltage dimmers for magnetic or inductive loads. Refer to Luminii website for a list of compatible dimmers.

Line LED
24 VDC

dimmer

LINE VOLTAGE
120, 244, or 277 VAC, depends on model ordered.

PSD 24V Class 2 dimming series - Installation Instructions

Models PSD-48-24, PSD-96-24, and PSD-288-24

Please read all instructions prior to installation and keep for future reference!

This power supply is to be installed by a qualified electrician in accordance with the National Electrical Code (NEC) and local building codes. The power supply must be installed in a well ventilated area and free from explosive gases and vapors. Proper operation requires the free flow of air. Power supply is well suited for LED or resistive loads at or below their maximum output rating per circuit.



7777 N. Merrimac
Ave Niles, IL 60714
T 224.333.6033
F 224.757.7557
info@luminii.com
www.luminii.com

Page 2 of 2

CLASS 2 POWER UNIT MODELS: PSD-XX-24-XXX

MOUNTING AND INSTALLATION INSTRUCTIONS

WARNING: The transformers and power supplies specified here must be installed by a qualified electrician in accordance with the National Electrical Code (NEC) and local building codes. Failure to do so will void the warranty and may result in serious injury and/or permanent damage to the unit.

1. This unit must be located 1 foot or greater above the deck or ground level.
2. Mount this unit on a suitable vertical surface with conduit opening down.
3. Using the ruler, measure the vertical mounting point distance for the bracket provided on the back of the enclosure.
4. Mark the mounting surface and drill a minimum of 2 holes to match the bracket holes centers. Size the drills to accommodate #10 mounting hardware.
5. If keyhole mounting brackets are provided, insert the hardware at the mounting point to allow for 3/16" spacing between the screw head and the mounting surface to accommodate the bracket thickness.
6. Refer to the product labeling for detailed line and load wiring procedure.
 - A. For connection, Use NO 12-22 AWG Cu wires insulated for a minimum of 90C, rated for 600V. Tightening torque 7 in-lbs for output terminal block.
 - B. Use wire connectors suitable for the number and size conductors being connected being connected and applied in accordance with the manufacture's instructions.
 - C. Minimum 20 amp supply side branch circuit.
 - D. A disconnect device shall be located in the field wiring.

IMPORTANT SAFETY INSTRUCTIONS

When using electrical products, basic precautions should be practiced including the following:

1. **READ AND FOLLOW ALL SAFETY INSTRUCTIONS**
2. Read and follow all instructions that are on the product or provided with the product.
3. Reference the National code, ANSI/NFPA 70, specifically for the installation of wiring and clearances from power and lighting conductors.
4. Installation work and electrical wiring must be done by qualified person in accordance with all applicable codes and standards, including fire rated construction.
5. **WARNING:** Risk of Electrical Shock. When used outdoors, install only a circuit protected by Class A GFCI.
6. **WARNING:** Risk of fire. Installation involves special wiring methods to run through building structure. Consult a qualified electrician.
7. **WARNING:** Risk of Electrical Shock. Mount the unit at a greater height than 1 foot from the ground surface.

SAVE THESE INSTRUCTIONS - This insert contains important safety and operating instructions for power units.