


Raychem

RTD3CS and RTD10CS

RTD TEMPERATURE SENSORS FOR TEMPERATURE MEASUREMENT UP TO 400°F (204°C) INSTALLATION INSTRUCTIONS

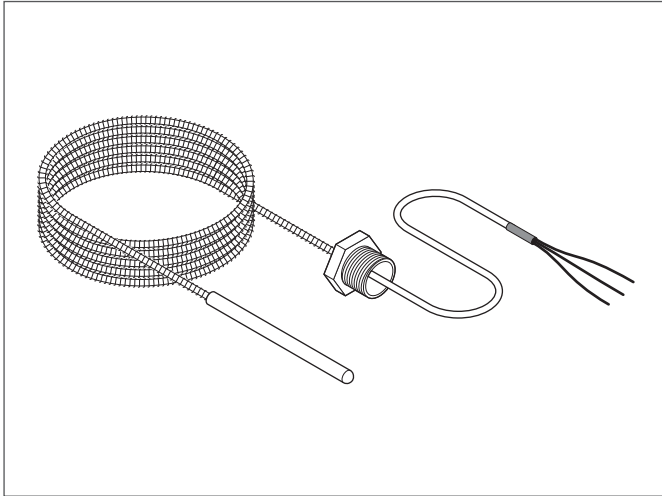

APPROVALS

Approvals associated with control device, however not to be used in Div. 1 locations.

SPECIFICATIONS

Sensor	
Housing	316 stainless steel
Dimensions	3 in (76 mm) length 3/16 in (8 mm) diameter
Sensing area	1½ in (38 mm)
Accuracy	±1°F (0.5°C) at 32°F (0°C)
Range	-76°F to 400°F (-60°C to 204°C)
Resistance	100 ohms at 0°C $\alpha = 0.00385$ ohms/ohm/°C

DESCRIPTION

The RTD3CS and RTD10CS are three-wire platinum RTD (resistance temperature detectors) typically used with monitoring and control systems, such as our Raychem 910 controller, when accurate temperature control is required.

The RTD3CS and RTD10CS can be installed directly to the controller using the supplied ½ inch conduit fitting or to an RTD junction box where RTD extension wire is used.

TOOLS REQUIRED

- 3.5-mm flat-blade screwdriver

ADDITIONAL MATERIALS REQUIRED

- AT-180 aluminum tape

KIT CONTENTS

Qty	Description
1	RTD temperature sensor

Extension Wires


Wire size (each of 3)	20 AWG, stranded tinned copper
Wire insulation rating	300 volts
Length	RTD3CS: 3 ft (.3 m) flexible armor, 18 in (457 mm) lead wire RTD10CS: 10 feet (3 m) flexible armor, 18 in (457 mm) lead wire
Outer shield	Stainless steel flexible armor
Maximum exposure temperature	400°F (204°C)
Conduit bushing	½ in NPT

WARNING:

This component is an electrical device. It must be installed correctly to ensure proper operation and to prevent shock or fire. Read these important warnings and carefully follow all the

installation instructions. Component approvals and performance are based on the use of specified parts only. Do not use substitute parts or vinyl electrical tape to make connections.

POSITIONING THE SENSOR

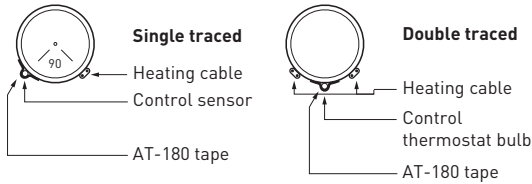

Position the RTD sensor in the lower quadrant of the pipe as shown in the diagram. **Place the RTD sensor at least 3 feet (1 m) from pipe supports, valves, or other heat sinks.** Tape the RTD firmly to the pipe with AT-180 aluminum tape, making sure there is no air space between the RTD and the pipe. **Do not use the same piece of AT-180 tape to overlap the RTD and heat-trace cable.**


INSTALLATION WITH HEATING CABLE

Electrical Wiring Guidelines:

Most electrical codes (such as NEC 725.15) permit Class 1 circuits to occupy the same cable, enclosure, or raceway without regard to whether the individual circuits are alternating current or direct current, providing all conductors are insulated for the maximum voltage of any conductors in the cable, enclosure or raceway.

Additional Materials Required


- JBS-100-A or other power connection kit
- Pipe straps

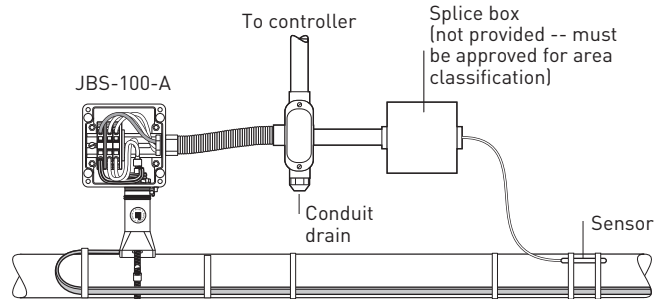

RTD DIRECT CONNECTION TO CONTROLLER


(Distance from sensor bulb to controller must be less than 10 feet)

The RTD3CS and RTD10CS can be terminated directly at the controller using the supplied ½ inch NPT fitting. In this configuration, no additional extension wire is required.

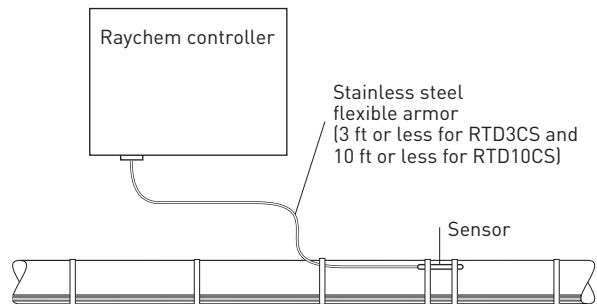

RTD DIRECT CONNECTION TO CONTROLLER


(Distance from sensor bulb to controller greater than 3 feet for the RTD3CS and 10 feet for the RTD10CS)

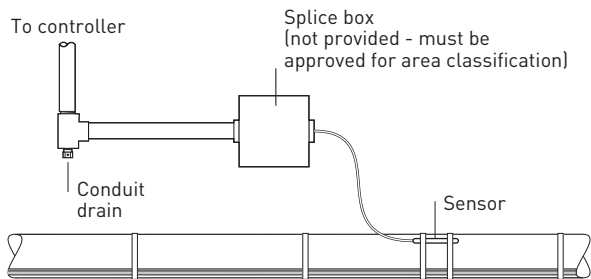

RTD3CS AND RTD10CS WIRING

Connect the wires as shown.

Note: Ground RTD extension wire shield at one end only, preferably at Raychem electronics end.

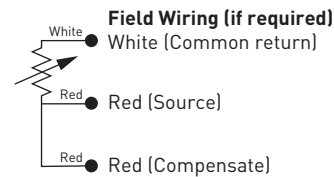

WWW.PENTAIRTHERMAL.COM

NORTH AMERICA

Tel: +1.800.545.6258
 Fax: +1.800.527.5703
 Tel: +1.650.216.1526
 Fax: +1.650.474.7711
 thermal.info@pentair.com

EUROPE, MIDDLE EAST, AFRICA

Tel: +32.16.213.511
 Fax: +32.16.213.603
 thermal.info@pentair.com

ASIA PACIFIC

Tel: +86.21.2412.1688
 Fax: +86.21.5426.2937
 cn.thermal.info@pentair.com

LATIN AMERICA

Tel: +1.713.868.4800
 Fax: +1.713.868.2333
 thermal.info@pentair.com

Pentair is owned by Pentair or its global affiliates. All other trademarks are the property of their respective owners. Pentair reserves the right to change specifications without prior notice.

© 2001-2017 Pentair.

@PentairThermal